
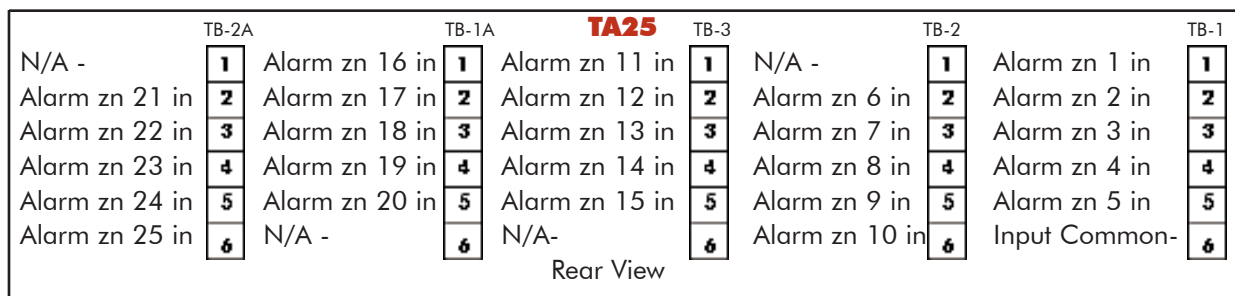
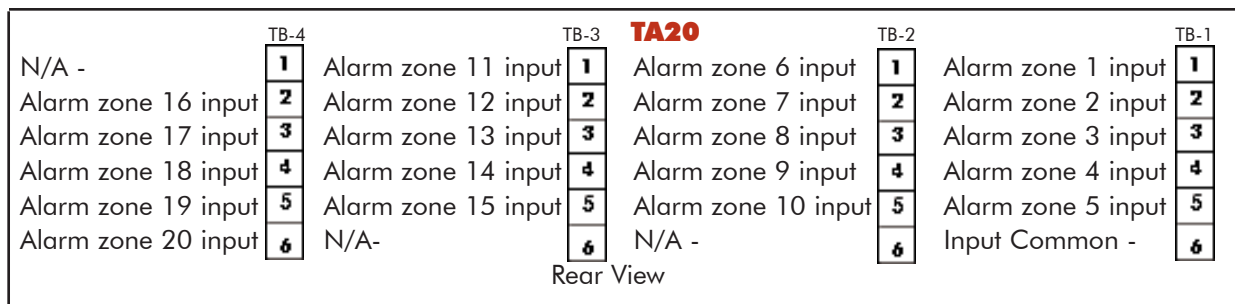
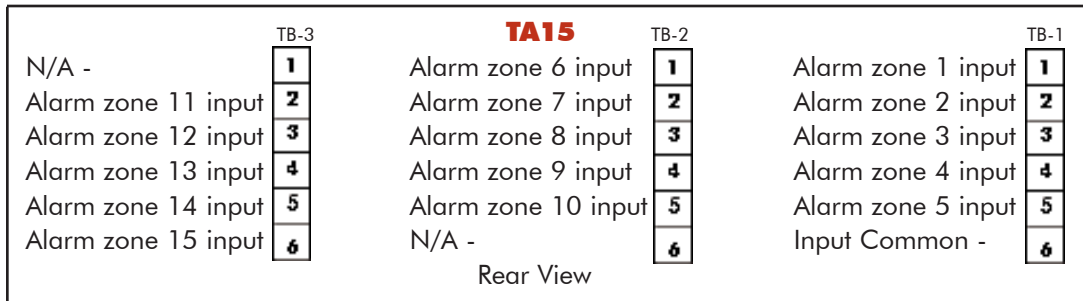
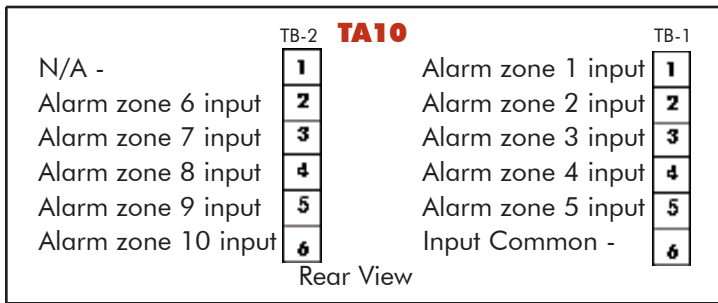


Keltron TA Series TA05-TA25 Installation Diagram

Voltage: Current limited* 24VDC 12VDC Common: Positive Negative

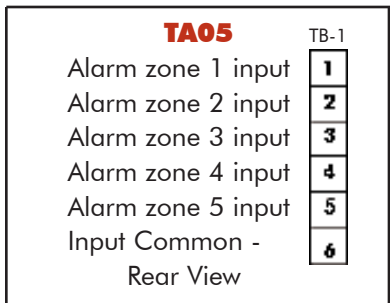

Note terminal rating: 24VDC annunciators all terminals 24VDC @ 20mA
12VDC annunciators all terminals 12VDC @ 20mA
Current limited annunciators all terminals 2VDC @ 20mA

*Caution on current limited annunciators, inputs must be limited to 20mA by the control panel. If this is not possible in-line resistors must be installed before power is applied.