
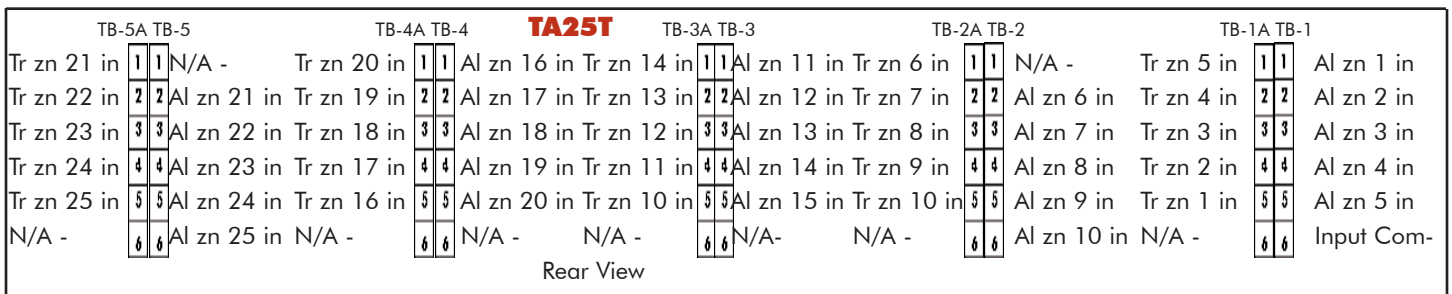
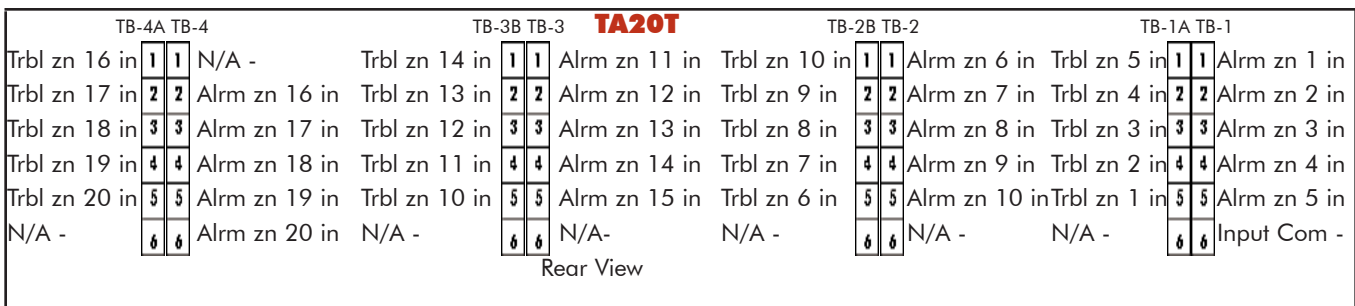
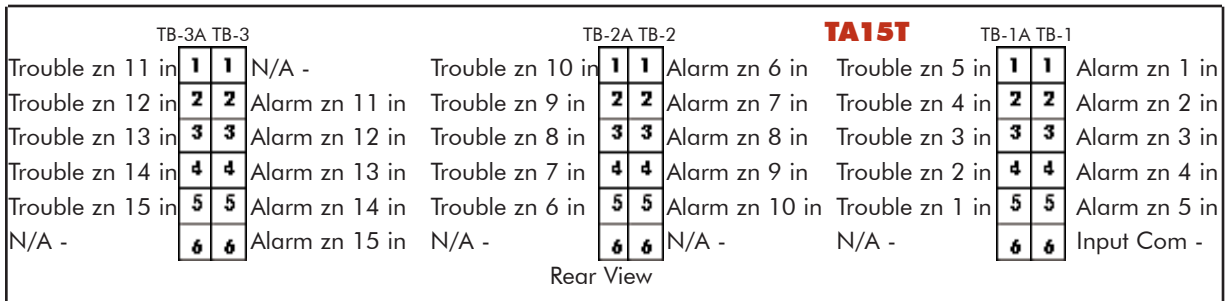


## Keltron TA Series TA05T-TA25T Installation Diagram

Voltage:  Current limited\*  
 24VDC  12VDC  
 Common:  Positive  Negative

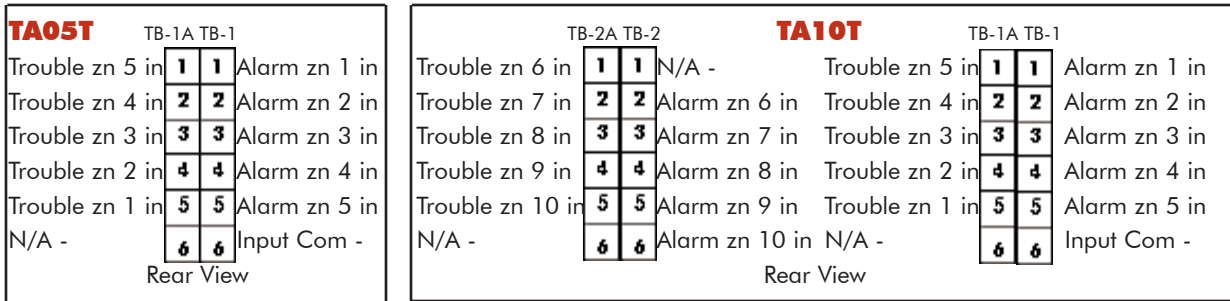

Note terminal rating: 24VDC annunciators all terminals 24VDC @ 20mA  
 12VDC annunciators all terminals 12VDC @ 20mA  
 Current limited annunciators all terminals 2VDC @ 20mA

\*Caution on current limited annunciators, inputs must be limited to 20mA by the control panel. If this is not possible in-line resistors must be installed before power is applied.